


Grunnmynd lagna á millilofti 1/50

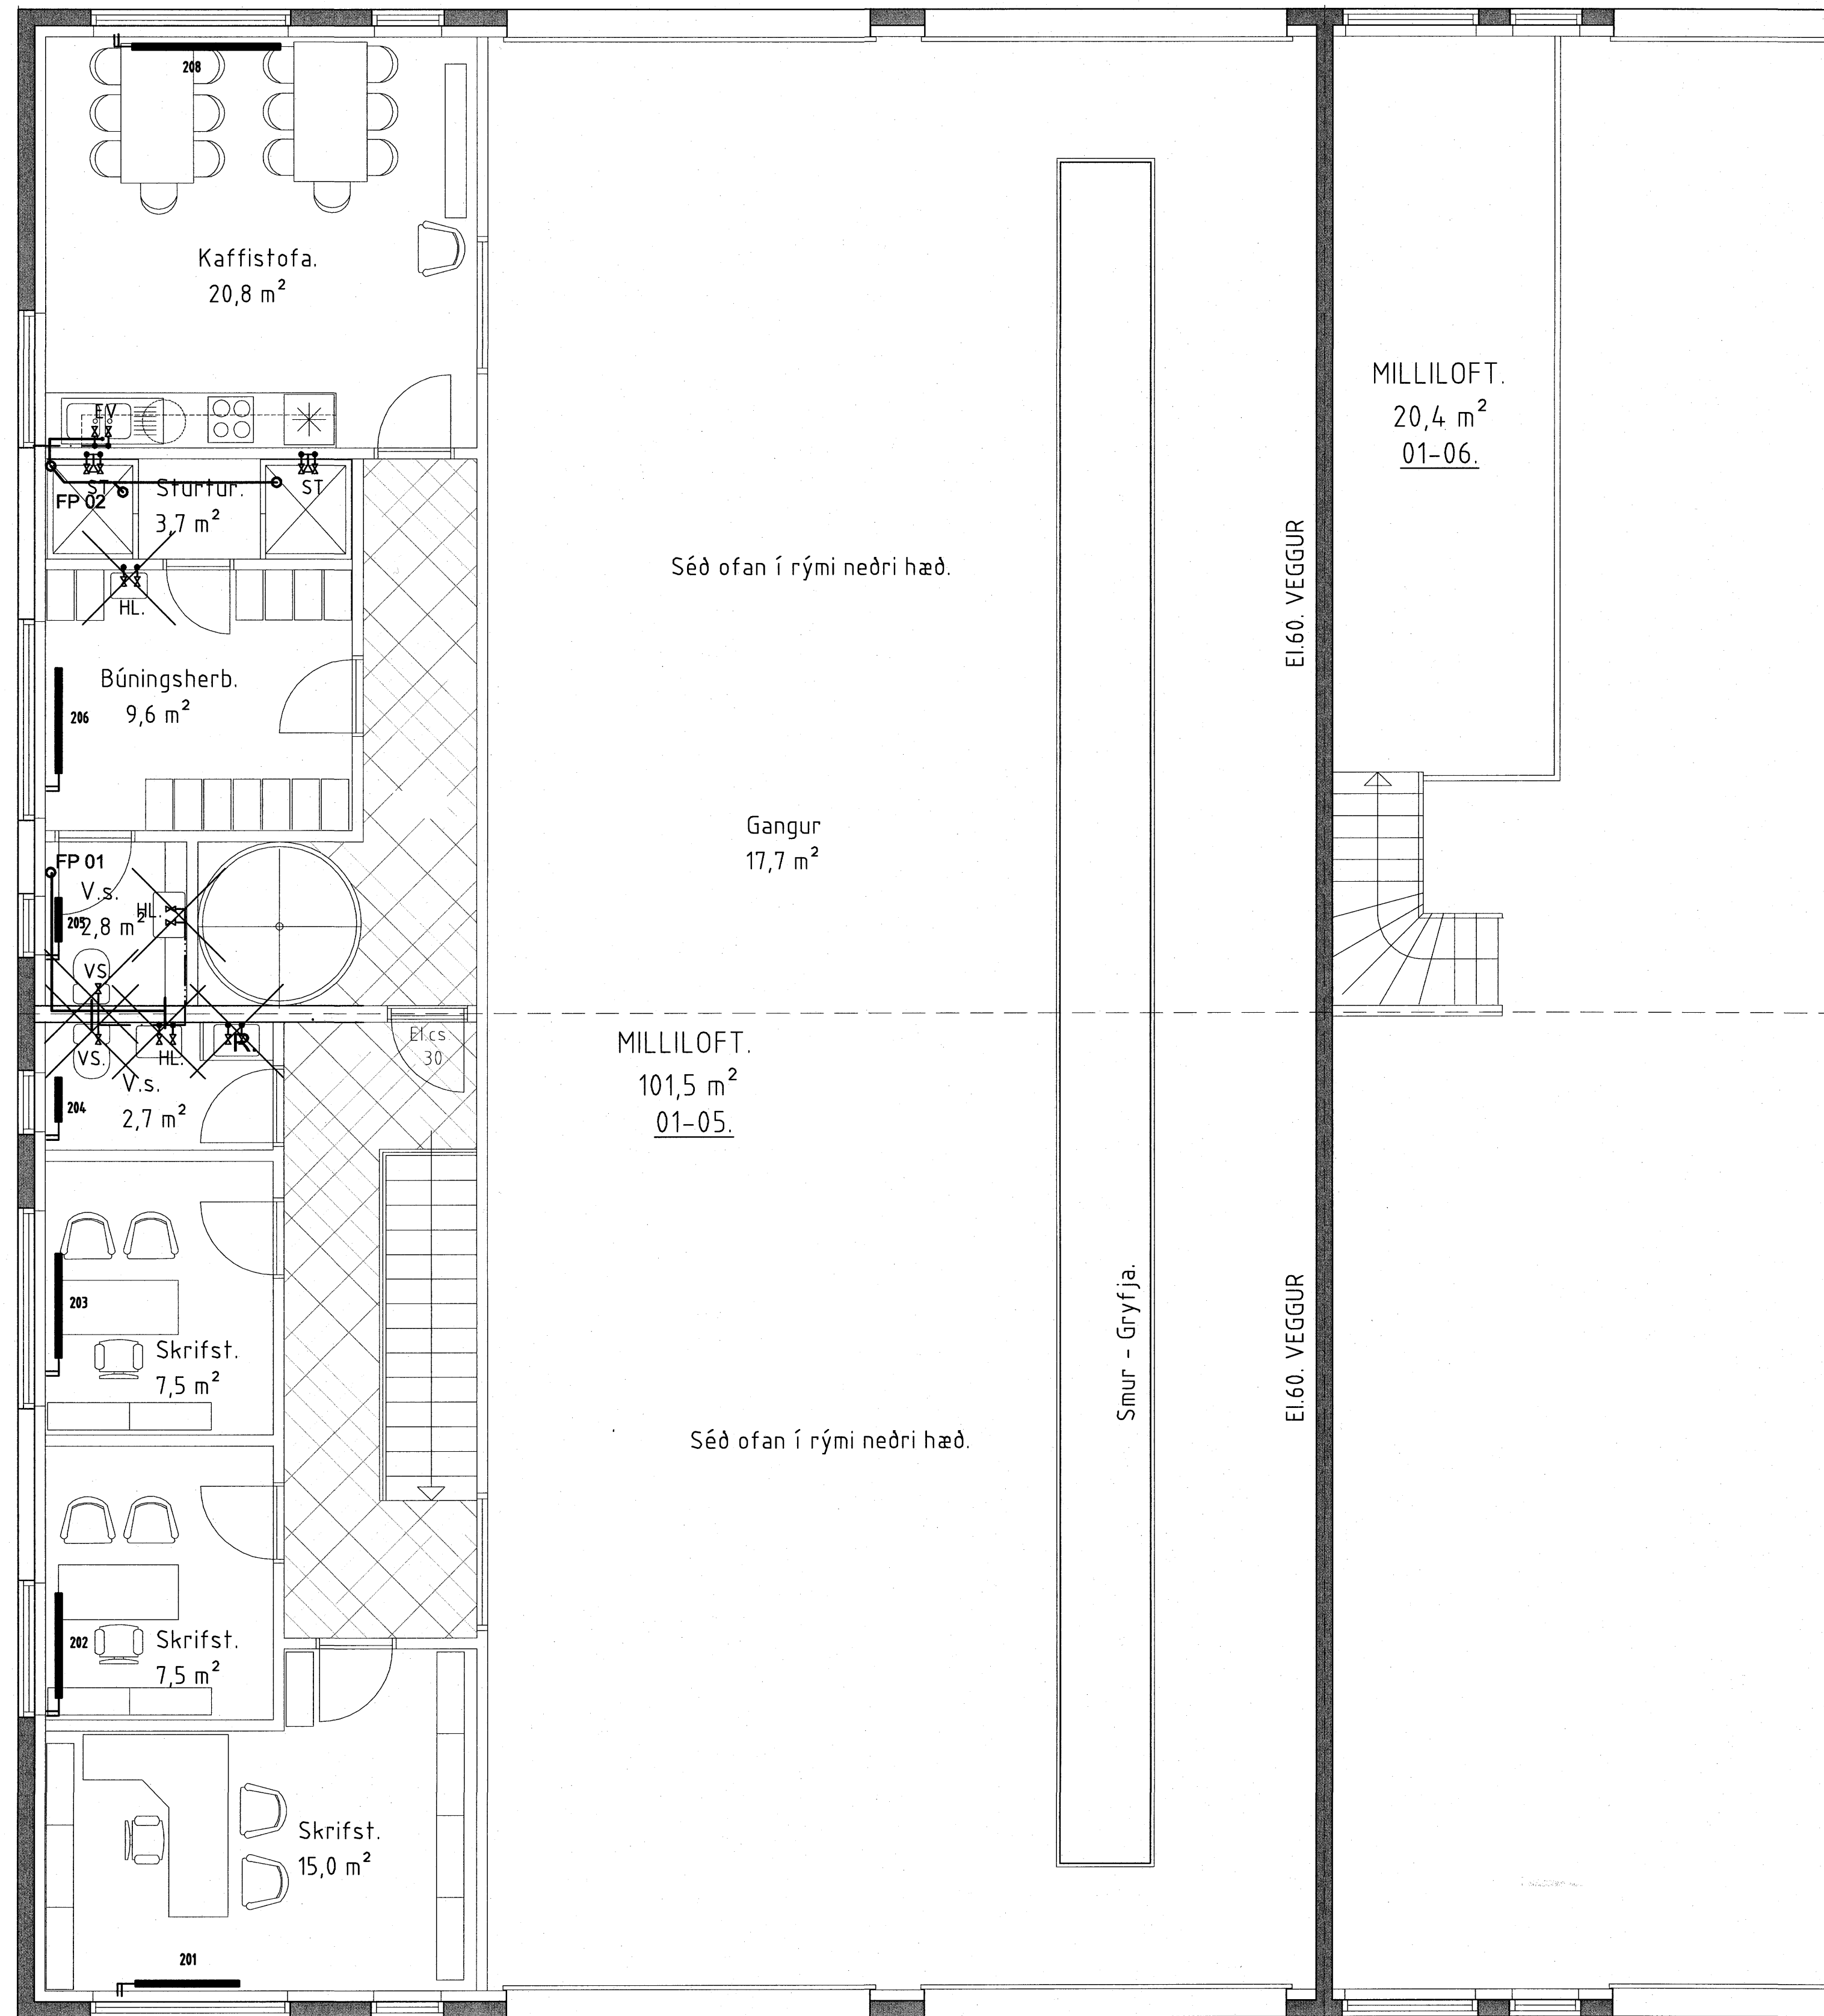


OFNASKRÁ:

ofn nr	mesta lengd mm	mesta hæð mm	minnstu afköst Wött	Krani
001	1800	600	1200	lofhitastýrður
002	1200	600	1200	lofhitastýrður
003	1200	600	1200	lofhitastýrður
004	500	600	500	lofhitastýrður
005	1200	600	1200	vatnshitastýrður (retúr)
006	1200	600	1200	vatnshitastýrður (retúr)
007	1200	600	1200	lofhitastýrður
008	500	600	500	lofhitastýrður
201	1800	600	1800	lofhitastýrður
202	1200	600	1200	lofhitastýrður
203	1200	600	1200	lofhitastýrður
204	500	600	500	lofhitastýrður
205	500	600	500	lofhitastýrður
206	1800	600	1800	lofhitastýrður
206	1800	600	1800	lofhitastýrður

Blásarar:
8 stk 1500 Wött hver

Dæmigerð útfærsla á hitablásara

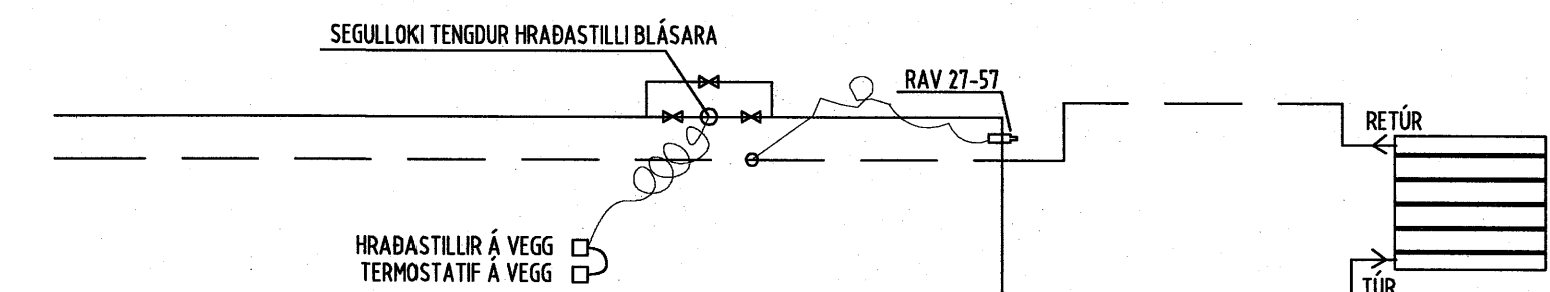

Samþykkt bann
04 JAN. 2008
Byggingfulltrúinn í Hafnarfirði
F.h. Sigurbjartur Halldórsson